



**SHENZHEN TOBY TECHNOLOGY CO., LTD.**

1A/F,Bldg.6,Yusheng Industrial Zone,The National Road No.107 Xixiang Section 46  
7, Xixiang,Bao'an,Shenzhen,China TEL:0755-26509301/02 FAX:0755-26509195

**Conducted Emission Measurement**


File :7

Data :#9

Date: 2016-7-5

Time: 14:42:02

80.0 dBuV

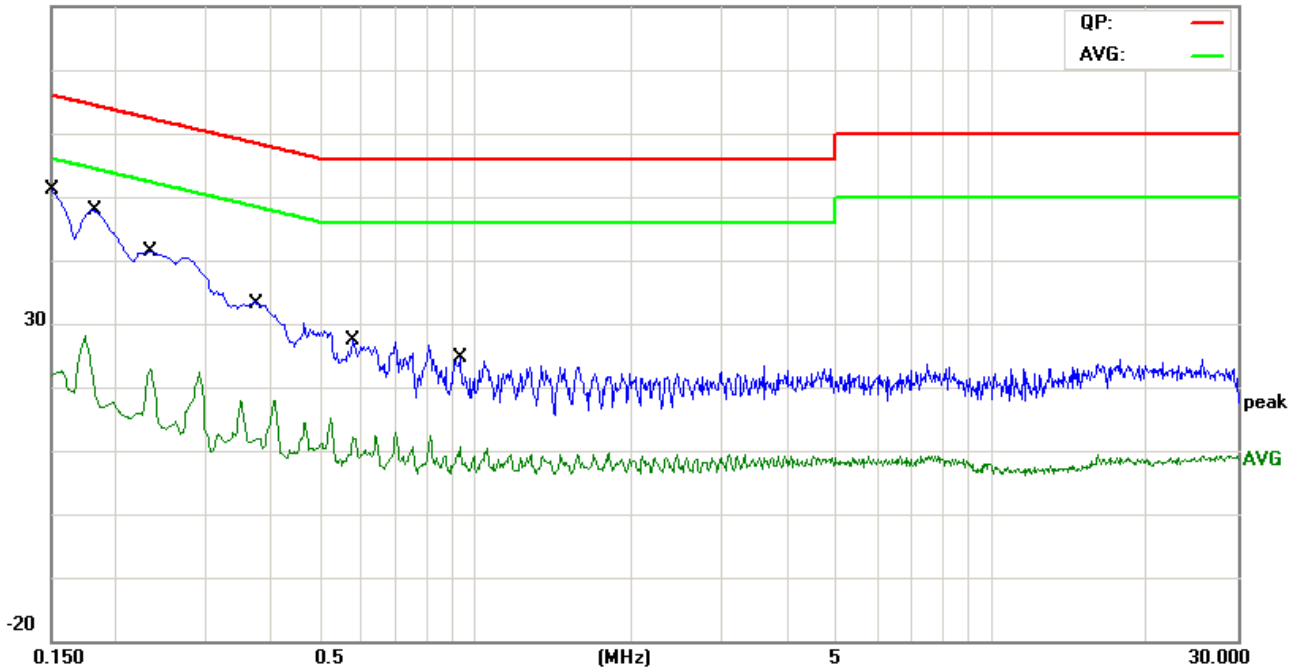

Site TOBY Chamber #1

Phase: **L1**

Temperature: 24 (C)

Limit: (CE)FCC PART 15 class B\_QP

Power: AC 120V/60Hz

Humidity: 55 %

EUT: Light

M/N: B1

Mode: Normal Mode

Note:

No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dBuV	Over dB	Detector	Comment
1	*	0.1500	31.29	9.92	41.21	65.99	-24.78	QP	
2		0.1500	5.85	9.92	15.77	55.99	-40.22	AVG	
3		0.1819	26.30	9.98	36.28	64.39	-28.11	QP	
4		0.1819	3.75	9.98	13.73	54.39	-40.66	AVG	
5		0.2340	19.18	10.02	29.20	62.30	-33.10	QP	
6		0.2340	6.03	10.02	16.05	52.30	-36.25	AVG	
7		0.3791	12.32	10.02	22.34	58.30	-35.96	QP	
8		0.3791	-1.58	10.02	8.44	48.30	-39.86	AVG	
9		0.5780	7.39	10.06	17.45	56.00	-38.55	QP	
10		0.5780	-1.77	10.06	8.29	46.00	-37.71	AVG	
11		0.9300	5.51	10.07	15.58	56.00	-40.42	QP	
12		0.9300	-2.24	10.07	7.83	46.00	-38.17	AVG	

\*:Maximum data x:Over limit !:over margin



**SHENZHEN TOBY TECHNOLOGY CO., LTD.**

1A/F,Bldg.6,Yusheng Industrial Zone,The National Road No.107 Xixiang Section 46  
7, Xixiang,Bao'an,Shenzhen,China TEL:0755-26509301/02 FAX:0755-26509195

**Conducted Emission Measurement**


File :7

Data :#10

Date: 2016-7-5

Time: 14:45:55

80.0 dBuV

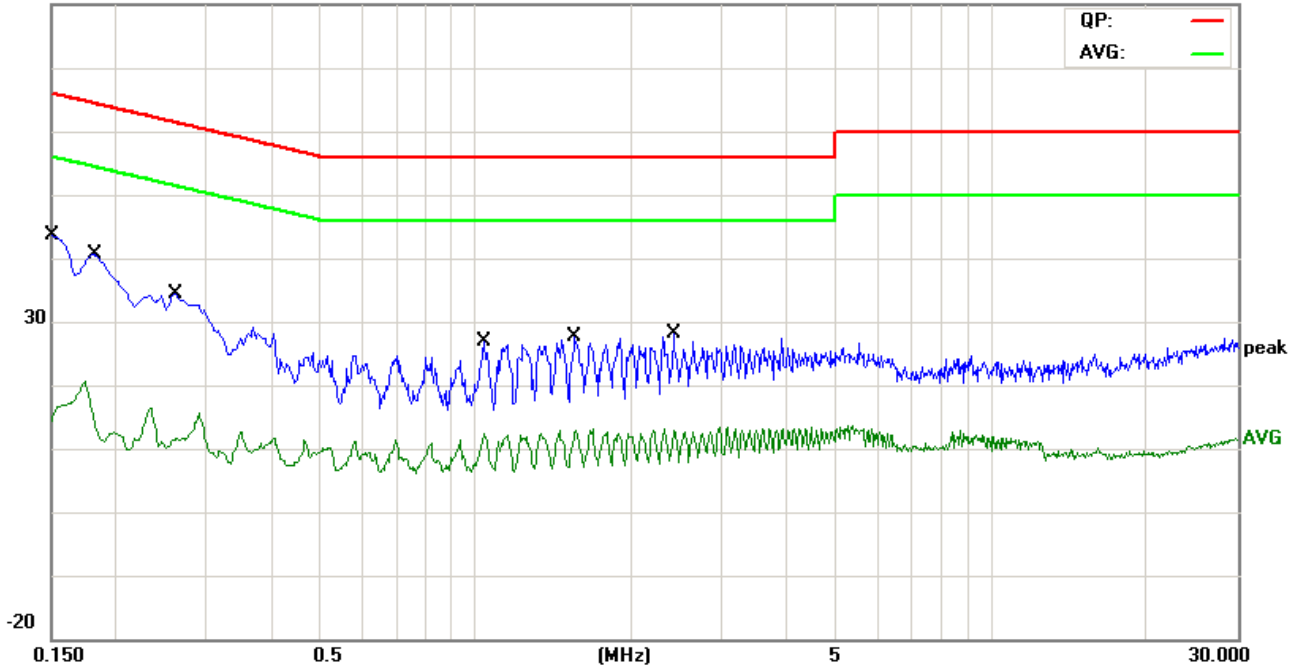

Site TOBY Chamber #1

Phase: **N**

Temperature: 24 (C)

Limit: (CE)FCC PART 15 class B\_QP

Power: AC 120V/60Hz

Humidity: 55 %

EUT: Light

M/N: B1

Mode: Normal Mode

Note:

No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dBuV	Over dB	Detector	Comment
1	*	0.1500	24.79	10.12	34.91	65.99	-31.08	QP	
2		0.1500	2.29	10.12	12.41	55.99	-43.58	AVG	
3		0.1819	19.04	10.12	29.16	64.39	-35.23	QP	
4		0.1819	-0.59	10.12	9.53	54.39	-44.86	AVG	
5		0.2620	13.94	10.10	24.04	61.36	-37.32	QP	
6		0.2620	-0.74	10.10	9.36	51.36	-42.00	AVG	
7		1.0339	7.75	10.16	17.91	56.00	-38.09	QP	
8		1.0339	-1.13	10.16	9.03	46.00	-36.97	AVG	
9		1.5580	7.86	10.10	17.96	56.00	-38.04	QP	
10		1.5580	-0.20	10.10	9.90	46.00	-36.10	AVG	
11		2.4180	6.56	10.06	16.62	56.00	-39.38	QP	
12		2.4180	-0.47	10.06	9.59	46.00	-36.41	AVG	

\*:Maximum data x:Over limit !:over margin